Prüfinstitut Hoch

Lerchenweg 1 D-97650 Fladungen Tel.: int – 49 – 9778-7480-200

Tel.: int – 49 – 9778-7480-200 hoch.fladungen@t-online.de

www.reaction-to-fire.de



Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch Testing, supervising and certifying body, authorized by the building supervision authority

TEST REPORT PZ-Hoch-220886

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

company

SAINT CLAIR TEXTILES

415, avenue de Savoie

F-38110 Saint Clair de la Tour

description of samples

-polyester fabric with PVC coating, in 3 different colours-

name of the material

..LAC 920"

sampling

by the company itself

content of request

Proof of flammability to classify building materials to class B1

"schwerentflammbar" according to DIN 4102, part 1

validity of test report

30.09.2027

result

The examined product meets in any colour the requirements of class B1 for "schwerentflammbare" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998), suspended freely or with distance of >40 mm to same or other plain

materials.

This test report includes 5 pages and 7 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:


- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval) or by
- "allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by "Zustimmung im Einzelfall" (exceptional approval)

- "Zustimmung im Einzelfall" (exceptional approval)
This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non-regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.





1. Description of test material in condition as delivered

PN 35694: "LAC 920" colour: grey

-polyester fabric with PVC coating-

side A: smooth, matt

characteristic values determined by the test laboratory:

area weight: about 946g/m²

thickness: about 0,71mm

PN 35695: "LAC 920"

colour: black

-polyester fabric with PVC coating-

side A: smooth, matt

characteristic values determined by the test laboratory:

area weight: about 874g/m²

thickness: about 0,71mm

PN 35696: "LAC 920"

" colour: white

-polyester fabric with PVC coating-

side A: smooth, matt

characteristic values determined by the test laboratory:

area weight: about 922g/m²

thickness: about 0,71mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

3. Arrangement of samples mounting: freely suspended

#5729:	flaming side A in warp direction	white
#5730:	flaming side B in warp direction	white
#5731:	flaming side B in weft direction	white
#5732:	flaming side B in warp direction	grey
#5733:	flaming side B in warp direction	black

4. Date of test

CW 39 in 2022



5. Results The test has been examined according to DIN 4102 (Mai 1998)

0	Measurement	Re	sult with	the tested	d specim	ien	Dim.
line no.	Test number	#5729	#5730	#5731	#5732	#5733	
≟	flaming direction / side	warp / A	warp / B	weft / B	warp / B	warp / B	
	colour of fabric		white		grey	black	
1	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	
2 3	Maximum flame height above bottom edge of the specimen Time 1)	70 0:13	70 0:12	80 0:20	80 0:17	80 0:17	cm min:s
4	Burn through / melting Time 1)	0:21	0:20	0:22	0:24	0:19	min:s
5	Observations on the back side of the specimen Flames / Glowing Time ¹⁾ Change of colour Time ¹⁾	 .J. .J.	 .J. .J.	 .J. .J.	 ./. ./.	 ./. ./.	min:s
7 8 9	Falling of burning droplets Start 1) Extent sporadic falling of burning droplets 2) continuous falling of burning droplets 2)	.J. 	X 0:21 X	.J. 	.J. 	./. 	min:s
10	Falling of burning droplets	./.	.J.	./.	.J.	J.	min:s
11 12	sporadic falling of burning droplets 2)						
13	After flame time at the bottom of the sieve (max.)	./.	0:04	.J.	.J.	./.	min:s
14	11110	.J.	. <i>I</i> .	J.	. <i>J</i> .	. <i>I</i> .	min:s
15	Final occurance of burning at the specimen 1)	1:50	2:55	3:35	1:40	2:25	min:s
16	Time of eventually end of test 1)	./.	./.	./.	.1.	./.	min:s
17 18 19 20 21	After flame after end of test Time 1) Number of specimen Front side of specimen 2) Back side of specimen 2) flame length	.1. .1. .1. .1.	./. ./. ./. ./.	.I. .I. .I. .I.	.I. .I. .I. .I.	./. ./. ./. ./.	min:s

	Measurement	Re	sult with	the tested	specim	en	Dim.
line no.	Test number	#5729	#5730	#5731	#5732	#5733	
i≣	flaming direction / side	warp / A	warp / B	weft / B	warp / B	warp / B	
	Afterglow after end of test	./.	./.	./.	./.	./.	
22	Time 1)	./.	./.	./.	./.	./.	min:s
23	Number of specimen	./.	./.	./.	./.	./.	
	Place of appearance	./.	./.	./.	./.	./.	
24	Lower half of the specimen 2)	./.	./.	./.	./.	./.	
25		./.	./.	./.	./.	./.	
26		./.	./.	./.	./.	./.	
27	Back side of specimen 2)	./.	./.	./.	./.	./.	
28 29 30	> 400 % * min ⁴⁾	68 ./. 1	55 ./. 2	54 ./. 3	66 ./. 4	not applicable ./. 5	% * min % * min
	Residual lengths: individual value ³⁾						
	Specimen 1	50	51	59	49	52	cm
31	Specimen 2	52	49	54	48	54	cm
	Specimen 3	50	51	54	47	51	cm
	Specimen 4	52	50	56	48	56	cm
32	Average value, individual test 3)	51	50	56	48	53	
33	Photo of specimen in enclosure no.	1	2	3	4	5	
34	Flue gas temperature	118	119	119	119	118	°C
35	Maximum of average value Time 1)	09:58	07:00	10:00	09:48	08:04	min:s
36	Diagram: encl. no.	1	2	3	4	5	
			2)			•	

indication of times: from the begin of testing procedure ²⁾ checked off if applicable indication of carrier/foam layer separated in case of fire-proofing agents very strong development of smoke



6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of more than 45 cm.

7. Summary of results and additional establishments to Fire Behaviour

o.	measurement	Result with the tested specimen										
ineno.	test-no.	#5729	#5730	#5731	#5732	#5733	Dim.					
		warp / A	warp / B	weft / B	warp / B	warp / B						
	colour of fabric		white	grey	black							
1	residual length	51	50	56	48	53	cm					
2	max. smoke temperature	118	119	119	119	118	°C					
3	density of smoke - integral	68	55	54	66	not applicable*1)	%min					
4	remarks: -none-											

^{*1)} Due to a failure of the measuring equipment the test has been terminated after 8:00min. The result was clearly positive. The smoke development is inconspicuous and similar to the other tests.

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6 & 7).

8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
 - o regular building materials for the required proof of accordance
 - o for not regular building materials for the required proof of applicability

9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 30.09.2022

clerk in charge:


(Dipl.-Ing.(FH) Jürgen Hammer)

Head of the test laboratory:

(Dipl.-Ing.(FH) Andreas Hoch)






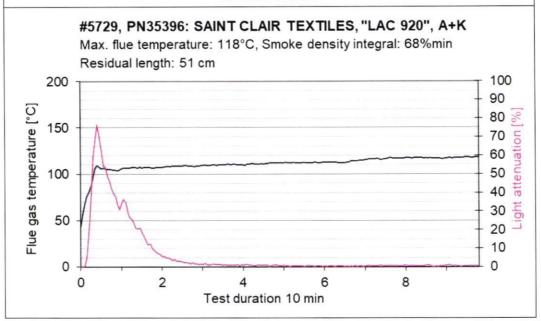





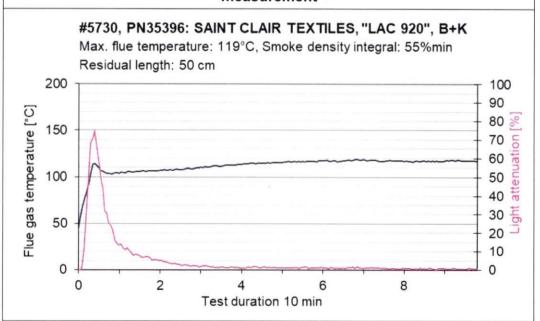






measurement #5731, PN35396: SAINT CLAIR TEXTILES, "LAC 920", B+S Max. flue temperature: 119°C, Smoke density integral: 54%min Residual length: 56 cm 200 100 90 Flue gas temperature [°C] 80 % 150 70 60 50 100 40 30 ₹ 50 20 10 0 0 0 2 8 Test duration 10 min






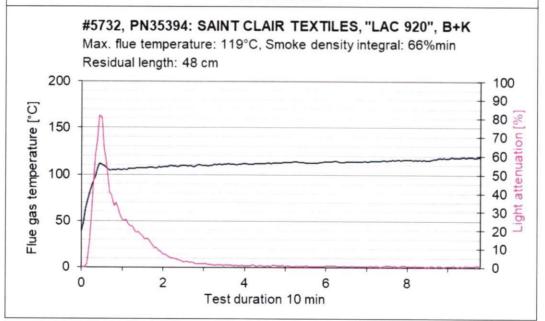

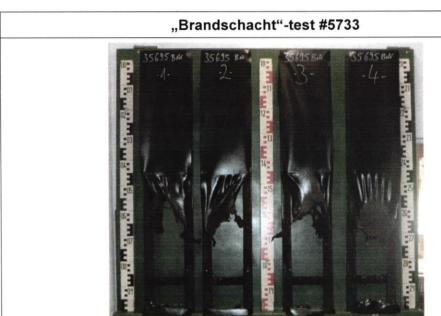

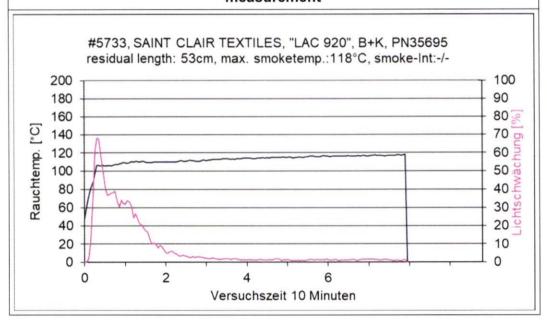



- 1. <u>Description of test material in condition as delivered</u> look at page 2
- 2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus. The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples: -freely suspended-

Flaming in warp and in weft direction / Flaming side A and side B

4. Date of test

CW 39 in 2022

5. Results

PN 35696: flaming side A in warp direction		edge-test							surface-test						
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Ei		
ignition ¹⁾	1	1	1	1	1		3						s		
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.	./.		./.						S		
max. flame height	8	8	8	8	8		5						cm		
time	15	15	15	15	15		15								
self cessation of the flames end of afterflame ¹⁾	15	15	15	15	15		15						s		
end of glowing ¹⁾	18	18	18	18	18		./.						s		
flames were extinguished after ¹⁾	./.	./.	./.	./.	./.		./.						s		
smoke development (visual)			hea	vy					mode	erate					
dropping of burning material during 20 s1)	./.	./.	./.	./.	./.		./.						s		
Appearance after test: burned out till ma	Appearance after test: burned out till max. height 10 cm x width 3 cm														

PN 35696: additional tests		е	dge-t	est			surface-test						
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Dim
arrangement of samples side / direction	B/wa	A/we	B/we				B/wa	A/we	B/we				
ignition ¹⁾	1	1	1				3	3	3				s
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.				./.	./.	./.				s
max. flame height	8	8	8				5	5	5				cm
time	15	15	15				15	15	15				
self cessation of the flames end of afterflame ¹⁾	15	15	15				15	15	15				s
end of glowing ¹⁾	18	18	18				./.	./.	./.				s
flames were extinguished after1)	./.	./.	./.				./.	./.	./.				s
smoke development (visual)	heavy moderate												
dropping of burning material during 20 s ¹⁾	./.	./.	./.				./.	./.	./.				s
Appearance after test: burned out till ma	ax. heig	tht 10 (cm x w	/idth	3 cm			-710					

¹⁾ time mentioned from the beginning of the test 2) during 20 Sec -/- no appearance -- no information wa: warp direction / we: weft direction

1 √wa	2 B/wa	3 A/we	4 B/we	5	6	1	2	3	4	5	6	Dim
1		A/we	B/we			Ahua						
-	1					A/wa	B/wa	A/we	B/we			
		1	1			3	3	3	3			s
./.	./.	./.	./.			./.	./.	./.	./.			s
7	6	6	6			5	5	5	5			cm
15	15	15	15			15	15	15	15			
15	15	15	15			15	15	15	15			s
18	18	18	18			./.	./.	./.	./.			s
./.	./.	./.	./.			./.	./.	./.	./.			s
heavy moderate												
./.	./.	./.								s		
1 1 .	7 5 5 8 7.	7 6 5 15 5 15 8 18 7/.	7 6 6 5 15 15 5 15 15 8 18 18 7 7 7 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8 8	7 6 6 6 5 15 15 15 15 5 15 15 15 15 8 18 18 18 18 7. 7. 7. 7. 7. heavy	7	7	7 6 6 6 5 15 15 15 15 15 15 15 15 15 15 18 18 18 18/. heavy //////.	7 6 6 6 5 5 5 15 15 15 15 15	7 6 6 6 5 5 5 5 5 5 5 5 5 5 5 5 5 5	7 6 6 6 5 5 5 5 5 5 5 5 5 5 5 5 5 5	7	7

PN 35695: additional tests		е	dge-t	est			surface-test							
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Dim	
arrangement of samples side / direction	A/wa	B/wa	A/we	B/we			A/wa	B/wa	A/we	B/we				
ignition ¹⁾	1	1	1	1			3	3	3	3			s	
reaching the mark of measurement ¹⁾²⁾	./.	./.	./.	./.			./.	./.	./.	./.			s	
max. flame height	7	7	7	7			5	5	5	5			cm	
time	15	15	15	15			15	15	15	15				
self cessation of the flames end of afterflame ¹⁾	15	15	15	15			15	15	15	15			s	
end of glowing ¹⁾	17	18	18	18.			./.	./.	./.	./.			s	
flames were extinguished after ¹⁾	./.	./.	./.	./.			./.	./.	./.	./.			s	
smoke development (visual)	heavy							moderate						
dropping of burning material during 20 s ¹⁾	./.	./.	./.	./.			./.	./.	./.				s	
Appearance after test: burned out till ma	ax. hei	ght 10	cm x v	vidth 3	cm									

¹⁾ time mentioned from the beginning of the test 2) during 20 Sec -/- no appearance -- no information wa: warp direction / we: weft direction

- 6. Remarks and explanations to the testing procedure none -
- 7. Opinion concerning the dropping of burning material
 The test for normal flammability shows no burning dripping material.